


LUZON GRID (Actual Data) 2018 1st Quarter Reserve Profile

REVISION 3

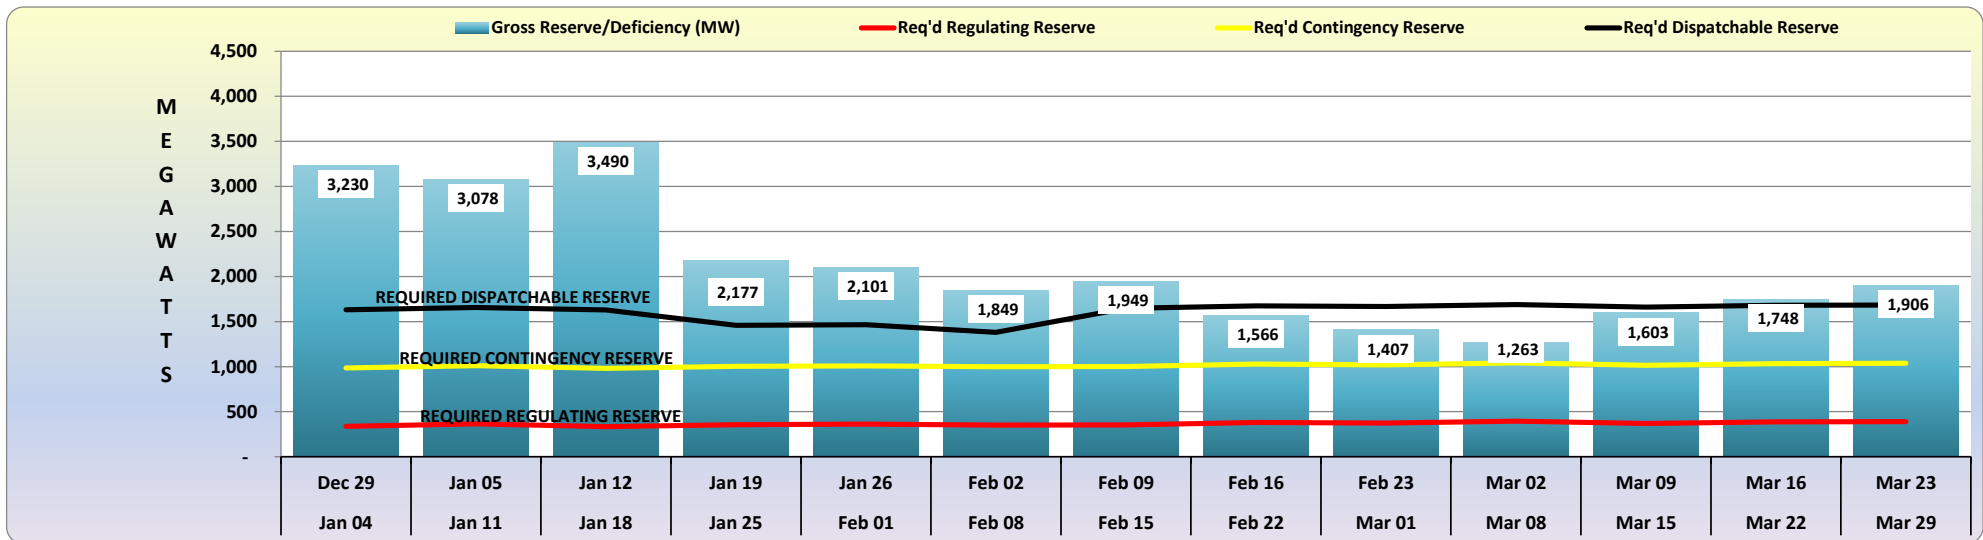


2018	1ST QUARTER													
	Dec 29	Jan 05	Jan 12	Jan 19	Jan 26	Feb 02	Feb 09	Feb 16	Feb 23	Mar 02	Mar 09	Mar 16	Mar 23	
	Jan 04	Jan 11	Jan 18	Jan 25	Feb 01	Feb 08	Feb 15	Feb 22	Mar 01	Mar 08	Mar 15	Mar 22	Mar 29	
Available Capacity (MW)	11,682	12,161	11,843	11,074	11,138	10,638	10,790	11,084	10,742	11,134	10,799	11,412	11,656	
Thermal	-	-	150	-	-	-	-	130	130	130	130	130	-	
Coal	4,611	4,729	4,672	4,252	4,272	3,966	3,711	3,851	3,208	3,851	3,580	4,245	4,736	
Gas Turbine/Diesel	567	558	566	562	561	566	549	543	538	528	534	578	625	
Combined Cycle/NatGas	3,817	3,747	3,430	3,040	3,121	3,176	3,677	3,571	3,723	3,625	3,806	3,747	3,830	
Geothermal	465	474	449	464	459	461	461	462	460	378	410	420	404	
HVDC	-	-	-	-	-	-	-	-	-	-	-	-	-	
Wind Farm	106	198	281	273	266	224	29	134	276	220	136	70	-	
Biomass	63	63	63	63	64	64	64	64	64	57	64	74	70	
Solar	163	158	-	179	161	-	154	199	191	202	214	186	-	
Hydro	1,890	2,234	2,232	2,241	2,234	2,181	2,145	2,130	2,152	2,143	1,925	1,962	1,991	
System Load (MW)	8,452	9,083	8,353	8,897	9,037	8,789	8,841	9,518	9,335	9,871	9,196	9,664	9,750	
Gross Reserve/Deficiency (MW)	3,230	3,078	3,490	2,177	2,101	1,849	1,949	1,566	1,407	1,263	1,603	1,748	1,906	
Req'd Regulating Reserve	338	363	334	356	361	352	354	381	373	395	368	387	390	
Req'd Contingency Reserve	647	647	647	647	647	647	647	647	647	647	647	647	647	
Req'd Dispatchable Reserve	647	647	647	456	456	382	647	647	647	647	647	647	647	

1. Peak Demand Forecast at 10,561 MW to occur in May 2018 based from the approved DOE Forecast for the Power Development Plan 2016 – 2040.
2. Preventive Maintenance of Power Plants considered.
3. Embedded Generators considered.

LUZON GRID (Actual Data) 2018 2nd Quarter Reserve Profile

REVISION 3

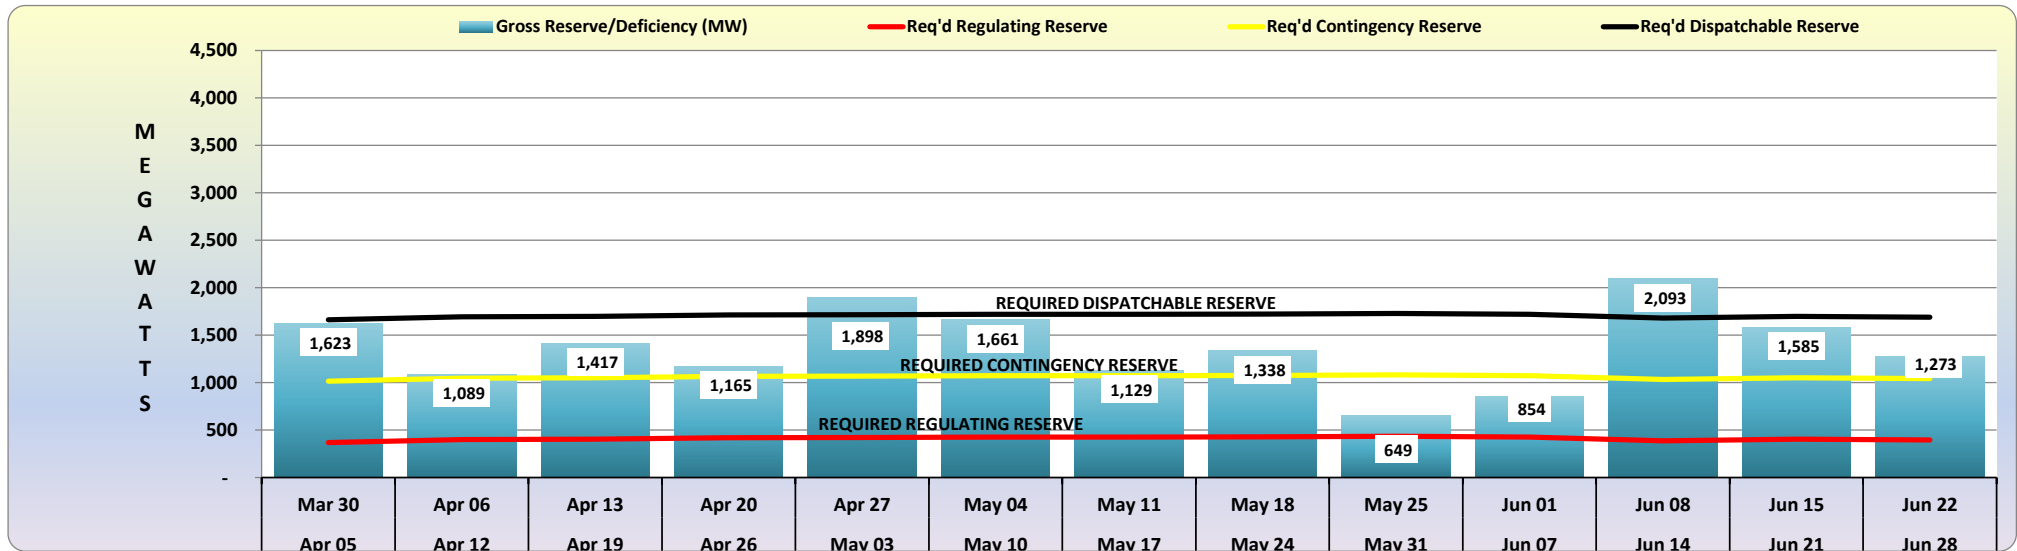


2018	2ND QUARTER													
	Mar 30	Apr 06	Apr 13	Apr 20	Apr 27	May 04	May 11	May 18	May 25	Jun 01	Jun 08	Jun 15	Jun 22	
	Apr 05	Apr 12	Apr 19	Apr 26	May 03	May 10	May 17	May 24	May 31	Jun 07	Jun 14	Jun 21	Jun 28	
Available Capacity (MW)	10,831	11,105	11,522	11,676	12,469	12,300	11,808	12,028	11,525	11,506	11,756	11,685	11,167	
Thermal	320	150	150	110	110	320	320	-	-	-	-	-	-	
Coal	4,647	5,106	5,008	5,304	5,631	5,096	4,774	5,191	5,365	4,910	5,090	4,869	4,667	
Gas Turbine/Diesel	560	532	560	554	541	559	555	551	509	525	509	534	359	
Combined Cycle/NatGas	3,101	2,847	3,129	3,149	3,803	3,726	3,628	3,715	3,696	3,657	3,702	3,515	3,681	
Geothermal	480	477	482	474	399	487	454	446	441	603	459	429	452	
HVDC	-	-	-	100	-	102	-	-	-	106	115	196	-	
Wind Farm	50	49	266	25	33	11	24	8	54	124	6	23	23	
Biomass	55	71	71	67	74	68	72	73	57	55	69	111	36	
Solar	83	158	154	185	198	201	98	195	-	218	140	95	-	
Hydro	1,535	1,715	1,702	1,708	1,680	1,730	1,883	1,849	1,403	1,308	1,666	1,913	1,949	
System Load (MW)	9,208	10,016	10,105	10,511	10,571	10,639	10,679	10,690	10,876	10,652	9,663	10,100	9,894	
Gross Reserve/Deficiency (MW)	1,623	1,089	1,417	1,165	1,898	1,661	1,129	1,338	649	854	2,093	1,585	1,273	
Req'd Regulating Reserve	368	401	404	420	423	426	427	428	435	426	387	404	396	
Req'd Contingency Reserve	647	647	647	647	647	647	647	647	647	647	647	647	647	
Req'd Dispatchable Reserve	647	647	647	647	647	647	647	647	647	647	647	647	647	

1. Peak Demand Forecast at 10,561 MW to occur in May 2018 based from the approved DOE Forecast for the Power Development Plan 2016 – 2040.
2. Preventive Maintenance of Power Plants considered.
3. Embedded Generators considered.

LUZON GRID (Actual Data) 2018 3rd Quarter Reserve Profile

REVISION 3

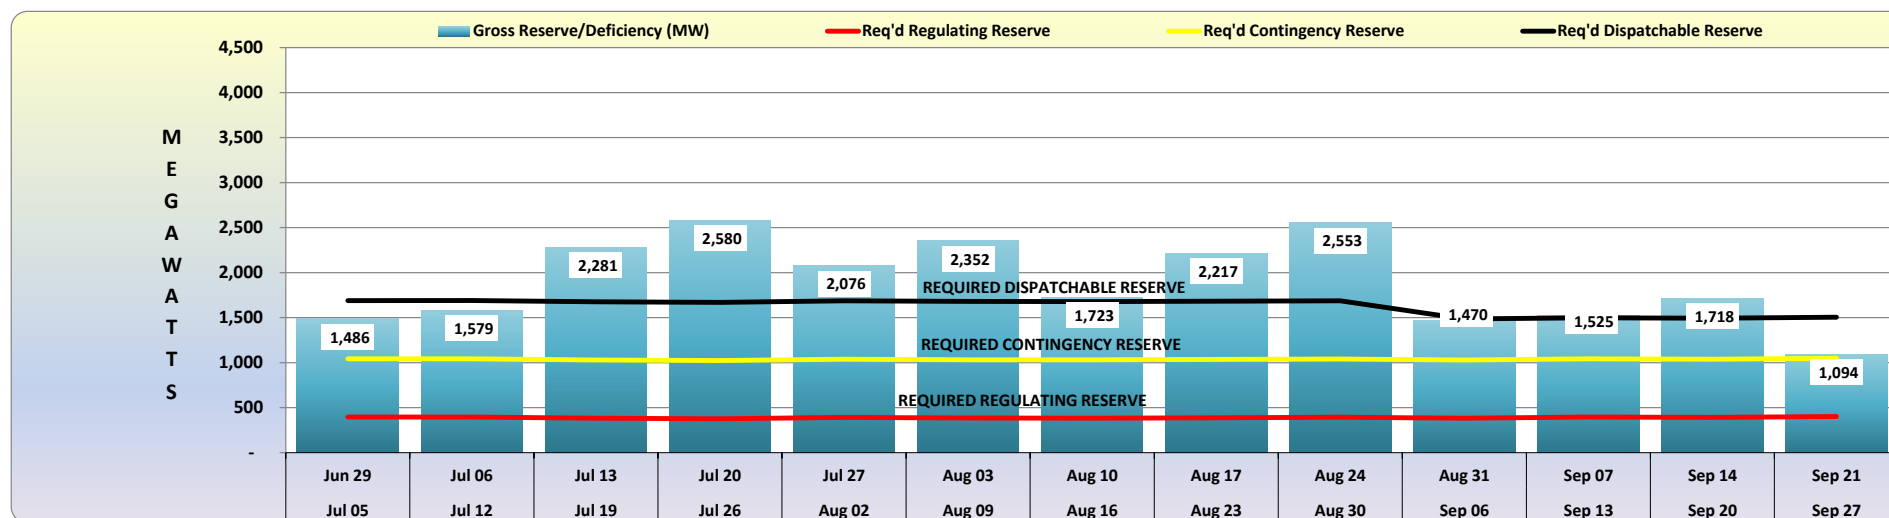


2018	3RD QUARTER												
	Jun 29	Jul 06	Jul 13	Jul 20	Jul 27	Aug 03	Aug 10	Aug 17	Aug 24	Aug 31	Sep 07	Sep 14	Sep 21
	Jul 05	Jul 12	Jul 19	Jul 26	Aug 02	Aug 09	Aug 16	Aug 23	Aug 30	Sep 06	Sep 13	Sep 20	Sep 27
Available Capacity (MW)	11,389	11,488	11,850	11,995	11,876	11,995	11,320	11,927	12,394	11,044	11,416	11,513	11,138
Thermal	-	-	-	-	-	-	-	-	-	-	-	-	-
Coal	4,669	4,697	5,429	5,461	5,022	5,188	4,671	5,229	5,526	4,149	4,876	4,760	4,163
Gas Turbine/Diesel	365	305	365	352	365	365	352	342	365	365	331	355	355
Combined Cycle/NatGas	3,704	3,708	3,609	3,609	3,600	3,603	3,337	3,343	3,610	3,635	3,162	3,375	3,659
Geothermal	450	434	446	446	433	432	468	459	454	448	448	454	441
HVDC	-	118	-	-	-	156	90	-	-	-	-	-	-
Wind Farm	107	82	14	-	99	32	131	256	5	-	127	7	28
Biomass	57	51	68	68	64	64	62	44	51	50	56	48	48
Solar	115	184	-	196	135	129	134	162	150	166	191	153	148
Hydro	1,922	1,909	1,919	1,863	2,158	2,026	2,075	2,092	2,233	2,231	2,225	2,361	2,296
System Load (MW)	9,903	9,909	9,569	9,415	9,800	9,643	9,597	9,710	9,841	9,574	9,891	9,795	10,044
Gross Reserve/Deficiency (MW)	1,486	1,579	2,281	2,580	2,076	2,352	1,723	2,217	2,553	1,470	1,525	1,718	1,094
Req'd Regulating Reserve	396	396	383	377	392	386	384	388	394	383	396	392	402
Req'd Contingency Reserve	647	647	647	647	647	647	647	647	647	647	647	647	647
Req'd Dispatchable Reserve	647	647	647	647	647	647	647	647	647	456	456	456	456

1. Peak Demand Forecast at 10,561 MW to occur in May 2018 based from the approved DOE Forecast for the Power Development Plan 2016 – 2040.
2. Preventive Maintenance of Power Plants considered.
3. Embedded Generators considered.

LUZON GRID 2018 4th Quarter Reserve Profile

REVISION 3

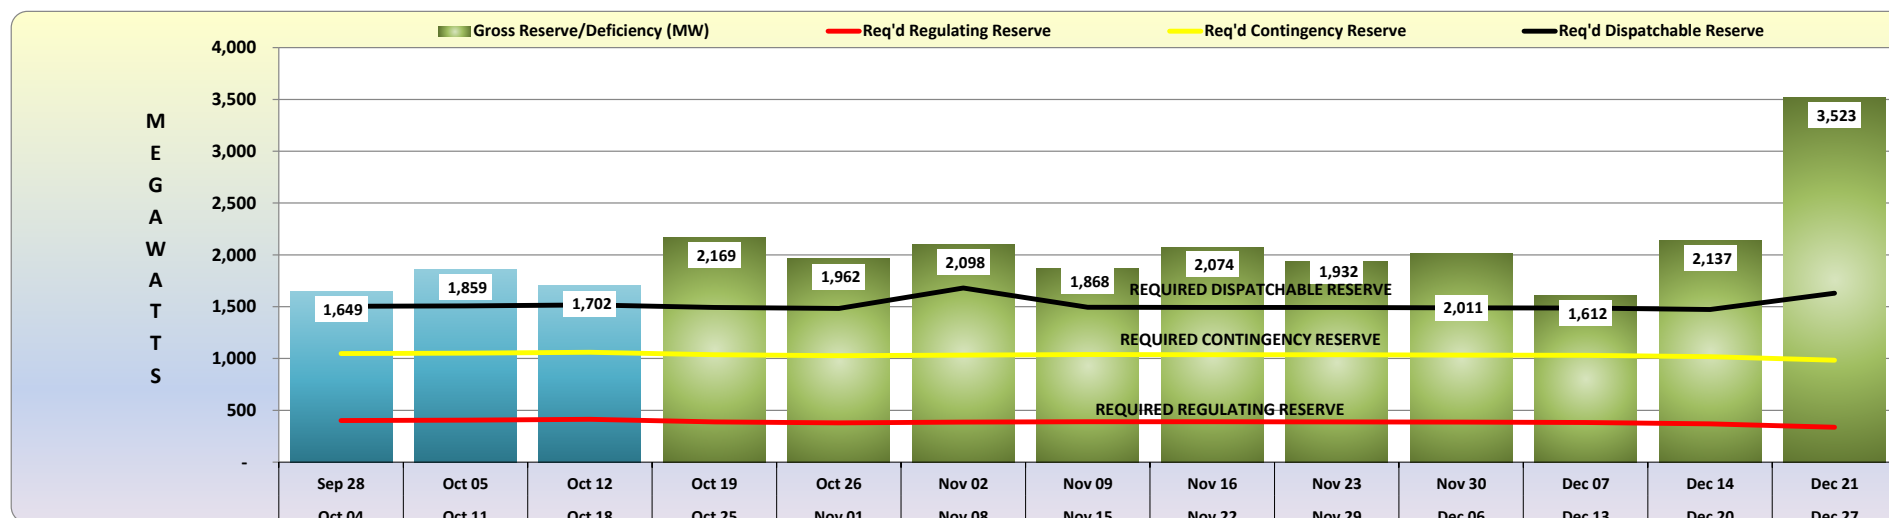

2018	4TH QUARTER													
	Sep 28	Oct 05	Oct 12	Oct 19	Oct 26	Nov 02	Nov 09	Nov 16	Nov 23	Nov 30	Dec 07	Dec 14	Dec 21	
	Oct 04	Oct 11	Oct 18	Oct 25	Nov 01	Nov 08	Nov 15	Nov 22	Nov 29	Dec 06	Dec 13	Dec 20	Dec 27	
Available Capacity (MW)	11,665	11,989	12,032	11,889	11,452	11,758	11,638	11,834	11,662	11,661	11,192	11,387	11,943	
Thermal	-	-	-	-	-	-	-	-	-	-	-	-	-	
Coal	4,576	4,869	4,917	5,045	5,045	5,692	5,045	5,045	5,045	5,032	4,882	4,882	5,342	
Gas Turbine/Diesel	365	365	468	439	439	439	439	439	439	433	433	433	439	
Combined Cycle/NatGas	3,620	3,659	3,564	3,650	3,213	3,213	3,740	3,830	3,830	3,830	3,320	3,320	3,410	
Geothermal	438	379	354	473	473	473	473	415	415	415	415	473	473	
HVDC	-	65	71	-	-	-	-	-	-	-	-	-	-	
Wind Farm	185	185	211	-	-	-	-	-	-	-	-	-	-	
Biomass	68	65	68	67	67	67	67	56	45	63	74	74	74	
Solar	159	174	186	-	-	-	-	-	-	-	-	-	-	
Hydro	2,254	2,228	2,193	2,215	2,215	1,874	1,874	2,049	1,888	1,888	2,068	2,205	2,205	
System Load (MW)	10,016	10,130	10,330	9,720	9,490	9,660	9,770	9,760	9,730	9,650	9,580	9,250	8,420	
Gross Reserve/Deficiency (MW)	1,649	1,859	1,702	2,169	1,962	2,098	1,868	2,074	1,932	2,011	1,612	2,137	3,523	
Req'd Regulating Reserve	401	405	413	389	380	386	391	390	389	386	383	370	337	
Req'd Contingency Reserve	647	647	647	647	647	647	647	647	647	647	647	647	647	
Req'd Dispatchable Reserve	456	456	456	456	456	647	456	456	456	456	456	456	647	

1. Peak Demand Forecast at 10,561 MW to occur in May 2018 based from the approved DOE Forecast for the Power Development Plan 2016 – 2040.
2. Preventive Maintenance of Power Plants considered.
3. Embedded Generators considered.